


Predicted airborne sound insulation between rooms

Predicted apparent sound reduction index R' (direct and flanking transmission) estimated in accordance with EN/ISO 12354-1:2000 (simplified single-number model, Clause 4.4). This is a prediction from element data, not a measurement. R'_w per ISO 717-1.

Client:	Example client	Sample area $S [m^2]$:	11.5
Description:	Separating wall, $R_{s,w} = 57$ dB (EN 12354-1 Annex H.3)	Test room:	Dwelling A to dwelling B (example)
Date of test:	2026-07-21	Source room volume $[m^3]$:	53
Receiving room volume $[m^3]$:	50		

Transmission paths $R_{ij,w}$ [dB]

Dd	57
floor-Ff	65.5
floor-Df	66
floor-Fd	66
ceiling-Ff	64.5
ceiling-Df	64.8
ceiling-Fd	64.8
facade-Ff	61.1
facade-Df	62.7
facade-Fd	62.7
intwall-Ff	73
intwall-Df	67.2
intwall-Fd	67.2

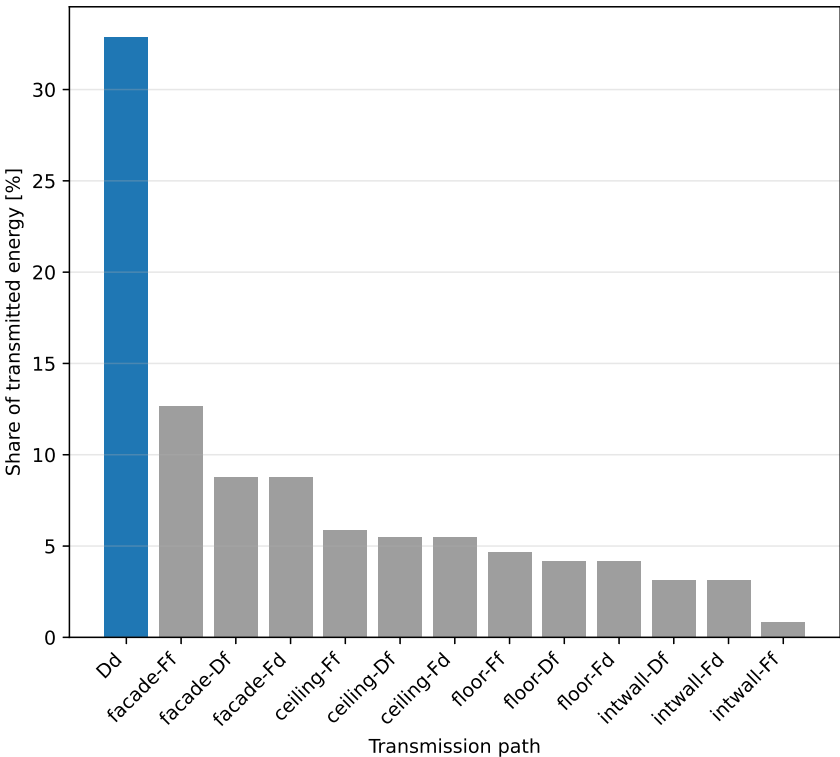

$R'_w = 52$ dB

Predicted (estimated) result computed from the building elements' performance by the EN/ISO 12354 simplified single-number model; it is not a measurement. The reported standard deviation of the model is about 2 dB.

Result vs requirement: $R'_w = 52$ dB, required ≥ 50 dB → **PASS**

Laboratory: Phonometry reference example

Report no.: EXAMPLE-12354-1

Date: 2026-07-21

Notes: Flanking elements: floor $R_w = 49$, ceiling 46, facade 42, internal wall 33 dB; junctions per Annex E/H. Simplified single-number model (Clause 4.4).

Operator: phonometry Signature: _____

■ The results relate only to the tested specimen.

Generated by phonometry.